



QwikDuct HDPE CUSTOM TEMPLATES



WHEN ORDERING CUSTOMER MUST SPECIFY:


1. **Material Thickness 3/8", 1/2", 3/4"**
and Load Rating Required (1/2" & 3/4" are special order materials)
2. Size & Location of Rebar Holes
3. Spacing Between Conduit Openings
4. Rebar Stake Down Slots Required?
5. Diameter of Conduits
6. Footage Between Templates
7. Size & Location of Concrete Flow Holes

WHEN ASSEMBLING ABOVE THE TRENCH:

1. Install Conduits into Templates & Rebar if Required
2. Lower Assemblies into Trench
3. Insert Stake Down Rods into Angled Slots
4. Drive Stake Down Rods into Trench Walls from Above
5. Backfill with Concrete, Slurry, Sand or Gravel etc.

SEE WEBSITE
VIDEO IP1-2

QwikDuct Templates can be used with all standardized trade size conduit specified per NFPA 70 NEC

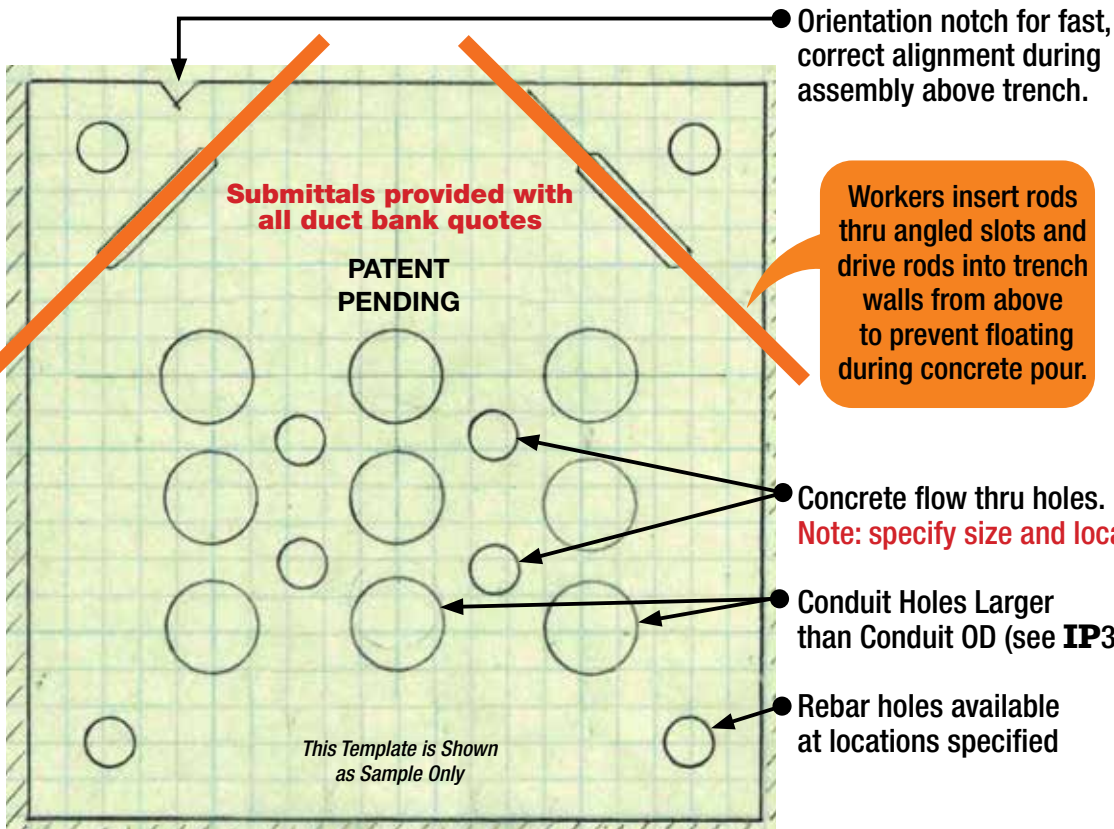

QWIKDUCT HDPE CUSTOM TEMPLATES meet or exceed US Army Corps of Engineers requirement.

Customer must specify larger diameter holes to enable feeding bell ends of conduit from either direction.

PROVIDE SAFER & FASTER INSTALLATION PLUS ALLOW CLOSING TRENCH QUICKER TO REDUCE CHANCE OF DANGEROUS & COSTLY SOIL OR WATER PROBLEMS.

ALSO SUITABLE FOR TRANSFORMER & SWITCHGEAR STUB UPS



PATENT PENDING
PATENTED



LABELS APPLY TO PRODUCTS ONLY WHERE SHOWN ABOVE

730 Pratt Boulevard • Elk Grove Village, IL 60007
P: (847) 593-8595 • F: (847) 593-8629 • Toll-free (800) 233-8595
E: info@spproducts.com • www.spproducts.com

IP2