

MSDS - QwikDuct Bore Spacers

QwikDuct HDPE Bore Spacers



**White virgin
material shown
DOESN'T qualify for
LEED CREDITS!**



**3/4" HDPE for Greater
Strength to Accommodate
Assemblies with Wheels.**

**2" Diameter Wheels are Standard, Larger
Size Diameters Available Upon Request**

**Roll assembled conduit into
caissons under obstructions.**

WHEN ORDERING CUSTOMER MUST SPECIFY:

1. **Material Thickness 3/8", 1/2", 3/4"** and Load Rating Required (1/2" & 3/4" are special order materials)
2. **Size & Location of Rebar Holes**
3. **Spacing Between Conduit Openings**
4. **Rebar Stake Down Slots Required?**
5. **Diameter of Conduits**
6. **Footage Between Templates**
7. **Size & Location of Concrete Flow Holes**
8. **Size, Number & Location of Wheels**

**Customer must specify larger diameter holes to enable
feeding bell ends of conduit from either direction.**



QwikDuct HDPE Dual Wall Bore Spacers

**HDPE made from
recycled material
may qualify for
LEED CREDITS!**



**3/4" HDPE for Greater
Strength to Accommodate
Assemblies with Wheels.**

**2" Diameter Wheels are Standard, Larger
Size Diameters Available Upon Request**

**Roll assembled conduit into
caissons under obstructions.**

WHEN ORDERING CUSTOMER MUST SPECIFY:

1. Material Thickness 3/8", 1/2", 3/4" and Load Rating Required (1/2" & 3/4" are special order materials)
2. Size & Location of Rebar Holes
3. Spacing Between Conduit Openings
4. Rebar Stake Down Slots Required?
5. Diameter of Conduits
6. Footage Between Templates
7. Size & Location of Concrete Flow Holes
8. Size, Number & Location of Wheels

**Customer must specify larger diameter holes to enable
feeding bell ends of conduit from either direction.**

metallic cylinder with an external diameter equivalent to the largest trade size raceway the support is intended for use with.

9A.2.5. For a conduit or tubing support of a polymeric material, or having a polymeric component, each assembly from Clause 9A.2.4 shall be tested in accordance with Clause 6.6 prior to conducting the load test described in Clause 9A.2.3. The samples shall cool to room temperature before being subjected to the pull test.

9A.3 Resistance to Impact

9A.3.1 As a result of the test described in Clauses 9A.3.2, the conduit or tubing support for use above ground only shall not crack, break, or show other damage that may impair the device's performance.

9A.3.1 Six samples of each type of conduit support being tested is to be exposed for 5 hours to air maintained at minus $35 \pm 1^\circ\text{C}$ (minus $31 \pm 2^\circ\text{F}$). Immediately after being removed from the cold chamber, each sample is to be dropped onto a concrete floor from a height of 5 feet (1.52 m).

10 Markings

10.10 The following, where applicable, shall be marked on the conduit or tubing support:

- a.) A catalog number or equivalent designation.
- b.) The largest size and type of raceway the support intended for use with.
- c.) Not for lifting or rigging of raceway bundles or equivalent wording.

10.11 A conduit or tubing support complying with the applicable load requirements of Clause 9A.2.3 shall be allowed to be marked on the device or the smallest unit shipping carton with the reference load rating corresponding to the load rating as specified in Tables 10-11.

TABLE 10
Load requirements for conduit or tubing support
(See Clauses 9A.2.3 and 9A.2.4)

		LOAD					
		Electrical Metallic Tubing (EMT) ^a		Rigid Metal Conduit (RMC), Intermediate Metal Conduit (IMC) ^{a,c}		Rigid PVC Conduit	
Trade Size	(Metric Designator)	Load (N)	Reference Load Rating (kg)	Load (N)	Reference Load Rating (kg)	Load (N)	Reference Load Rating (kg)
1/2	(16)	667	23	667	23	667	23
3/4	(21)	667	23	667	23	667	23
1	(27)	845	27	845	27	712	23


ILL. 1

1. Template - Made of HDPE. The body dimensions can be seen below.
Minimum thickness is 0.375 inches. Maximum overall template is 60 by 120 inches.
Minimum dimensions between conduit openings see ILL. 1.
For products marked cUL, the minimum spacing between conduit openings must be 190mm on center as shown in FIG. 1.

OPTIONAL: may be supplied with footing braces to provide stability.
See ILL. 2 for details.

2. Template - Same as above except round template 60 inch maximum diameter.

OPTIONAL: may be provided with wheels to assist with movement during end-use product installation. Provided with two 0.25" bolt holes and one 0.25" x 3" x 0.4375" deep slot per wheel axle/pin. Number and size of wheels may vary depending on intended end-use application. The dimensions of the slots (for the wheels) cut into the round template may vary depending on the size of the required wheels but shall not impede upon the spacing requirements shown in ILL. 1. See ILL. 3. for typical wheel installation.

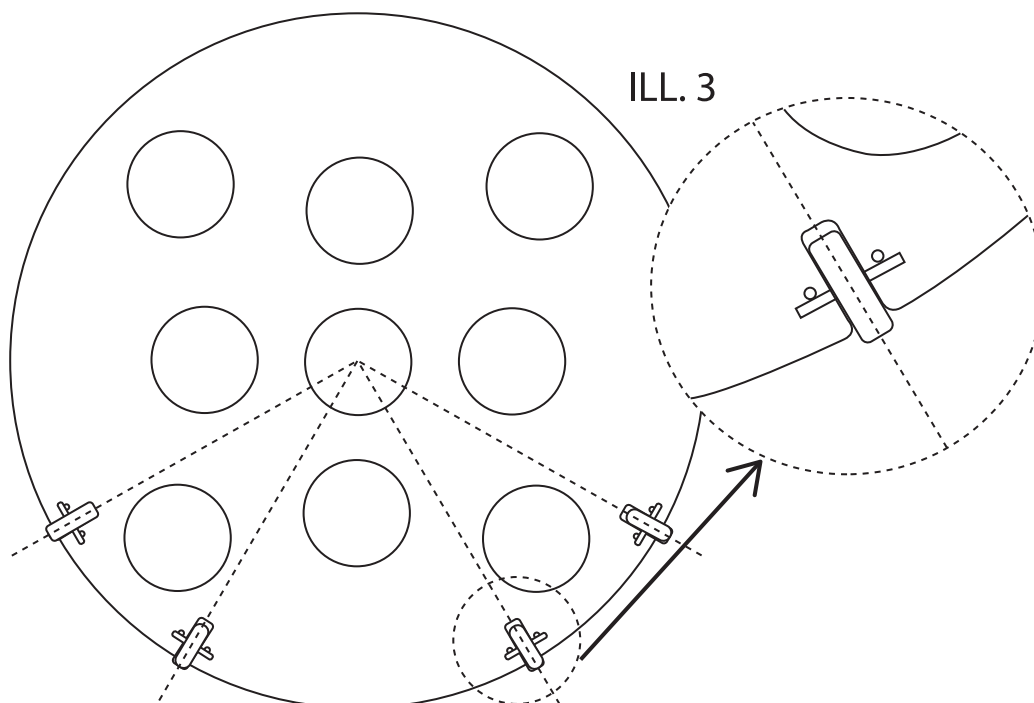

Polypropylene Wheels for Bore Spacer Templates


Wheel Type	Solid
Wheel/Tread Material	Polypropylene Plastic
Wheel Diameter	2" (Width-13/16") 3" (Width-15/15")
Hub Length	2" = 13/16" 3" = 15/15"
Capacity per Wheel	2" = 100 lbs. 3" = 150 lbs.
Hardness Rating	Hard
Hardness	Durometer 70D
Tread Shape	Flat
Nonmarking Wheels	Yes
Wheel Bearing Type	Without Bearing
Wheel Core Style	Solid
Temperature	-20° to 180° F
For Surface Type	Carpet, Concrete, Steel
For Use With	Oil, Solvents
Choose For Axle Diameter	2" = 5/16" 3" = 1/4"
Wheel Color	Black
RoHS Compliant	RoHS 3 (2015/863/EU)
REACH Compliant	REACH (EC 1907/2006) (01/1/2020, 205 SVHC)



Without Bearing

2" dia. x 13/36" wide x 5/16" axle

3" dia. x 15/36" wide x 1/4" axle

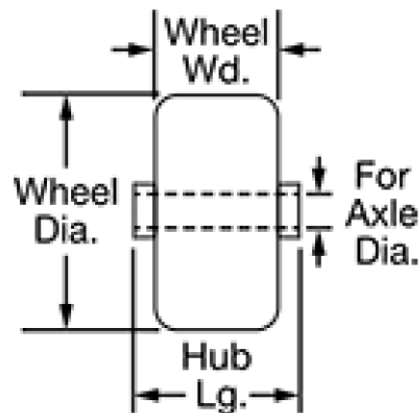

These lightweight wheels provide impact resistance on smooth surfaces.

They are the most economical wheel option.

Wheels without bearings ride directly on the axle, making them an economical choice for equipment not frequently moved.



CERTIFICATE OF COMPLIANCE

Certificate Number: 201904299-E185948
Report Reference: E185948-20120702
Issue Date: April 29, 2019

Issued to: SP Products, Inc.
730 Pratt Blvd.
Elk Grove Village, IL 6007-5115

This certificate confirms that
representative samples of:
QwikDuct

CONDUIT AND CABLE HARDWARE

Below Ground Conduit and Tubing Supports,

Have been investigated by UL in accordance with
the Standard(s) indicated on this Certificate

Standard(s) of Safety: Safety for Hardware for the Support of Conduit,
Tubing and Cable, UL 2239 and
CSA C22.2 No. 18.4-15

Additional Information: See the UL Online Certifications Directory at
<https://iq.ulprospector.com>
for additional information

This *Certificate of Compliance* does not provide authorization to apply the UL Mark.
Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and
covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

Bruce Mahrenholz, Director North American Certification Program UL LLC



Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licenses of UL.
For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>

NOTE: SP Product's
QwikDuct HDPE Templates
are made with 100% recyclable material
and may qualify for LEED Credits.





September 16th, 2022

This is to certify that SP Products, Inc. fabricates the QwikDuct HDPE Duct Bank Templates in United States of America.

Sincerely,

A handwritten signature in black ink that reads 'Mikel Bishka'.

Mikel Bishka
Prefab and Quotations Manager

SP Products Inc.
730 Pratt Blvd.
Elk Grove Village, IL 60007



August 7, 2019

To whom it may concern:

SP Products UL Listed QwikDuct Templates have been used in an extended number of federal projects in the past 20 years. See below for past completed jobs:

Ft Polk Louisiana - Coburn Bros. Electric, LA
Oakland Army Base - Oakland, CA - Morrow Meadows CA - Contractor
Project Elizabeth, Washington DC area - Nationwide Electric - Contractor
Department of Energy, Nuclear Weapons Facility - Amarillo, TX - Duke Energy Contractor
Lockheed Martin - Tamps, FL - Doyle Electric Contractor
TVA Bull Run - Department of Energy - Tennessee - ECA Contractor
Cape Canaveral, FL - MIL Conn Contractor
Enclave Kingsbay Submarine Project - MIL Con-Georgia
Austin, TX - Military Base - Bergelectric Contractor
Cottonwood Project - Colorado - Federal Hwy. Project - Northern Electric Contractor
Federal Dep of Aviation - O'Hare Airport - Chicago, IL - Aldridge Electric/BEI Electric Contractors

Please call if you have any questions.

Best regards.

Mikel Bishka
Prefab and Quotations Manager

SP Products Inc.
730 Pratt Blvd.
Elk Grove Village, IL 60007

QwikDuct HDPE Custom Templates

Material Safety Data Sheet

High Density Polyethylene			
Physical Properties	Metric	English	Comments
Specific Gravity	0.96 g/cc	0.0347 lb/in ³	ASTM D792
Water Absorption	Max 0.01 %	Max 0.01 %	Immersion, 24hr; ASTM D570(2)
WATER Absorption at Saturation	Max 0.01 %	Max 0.01%	Immersion, ASTM D570(2)
Mechanical Properties			
Hardness, Shore D	70	70	ASTM D2240
Tensile Strength, Ultimate	31.7 MPa	4600 psi	ASTM D638
Elongation at Break	400 %	400 %	ASTM D638
Tensile Modulus	1.38 GPa	200 ksi	ASTM D638
Flexural Modulus	1.2 GPa	174 ksi	ASTM D790
Flexural Yield Strength	31.7 MPa	4600 psi	ASTM D790
Compressive Strength	31.7	4600 psi	10% Def., 73°; ASTM D695
Compressive Modulus	0.689 GPa	100 ksi	ASTM D695
Coefficient of Friction	0.2	0.2	Dry vs. Steel; QTM55007
Izod Impact, Notched	0.694 J/cm	1.3 ft-lb/in	ASTM D256 Type A
Electrical Properties			
Surface Resistivity per Square	Min1e+015 ohm	Min1e+015 ohm	ASTM D257
Thermal Properties			
CTE, linear 68°F	110 µm/m-°C	61 µm/in-°F	(-40°F to 300°F); ASTM E831
Melting Point	127°C	260°F	Crystalline, Peak; ASTM D3418
Maximum Service Temperature, Air	82.2°C	180°F	Long Term
Deflection Temperature at 1.8 MPa (264 psi)	80°C	176°F	ASTM D648
Flammability, UL94*	HB	HB	1/8 inch
Qualitative Processing Properties			
Compliance - FDA	Compliant		
Machinability	3		1-10, 1=Easier to Machine
Service in Alcohols	Acceptable Service		
Service in Aliphatic Hydrocarbons	Unacceptable		

QwikDuct HDPE Custom Templates

Material Safety Data Sheet

Service in Aramatic Hydrocarbons	Unacceptable
Service in Chlorinated Solvents	Unacceptable
Service in Ethers	Unacceptable
Service in Ketones	Unacceptable
Service in Strong Acids	Acceptable Service
Service in Strong Alkalies	Acceptable Service
Service Sunlight	Limited Service
Service in Weak Acids	Acceptable Service
Service in Weak Alkalies	Acceptable Service

All statements, technical information and recommendations contained in this database are presented in good faith, based upon tests believed to be reliable and practical field experience.

This rating is not intended to reflect hazards presented by this or any other material under actual fire conditions.

QwikDuct HDPE Custom Templates

Material Safety Data Sheet

I. General Information		
Chemical Name & Synonyms High Density Polyethylene		Trade Name & Synonyms: Linear High Density Polyethylene Champline, Sanalite
Chemical Family Linear High Density Polyethylene		Formula (Ch2-ch2) n
Proper DOT Shipping Name: N/A		DOT Hazard Classification: N/A
II. Ingredients		
Principal Components	Percent	Threshold Limit Value (Units)
Polyethylene (CAS 9002-88-4)	>99%	10 mg/m3 (total dust)
III. Physical Data		
Boiling Point (Deg. F.) N/A	Specific Gravity (H2O=1) 0.96-0.97	
Vapor Pressure (mm Hg) N/A	Percent Volatile By Volume (%)	
Vapor Density (Air=1) N/A	Evaporation Rate (Air=1) N/A	
Solubility in Water Negligible	pH N/A	
Appearance & Odor Waxy Solid, White with Waxy Odor		
IV. Fire & Explosion Hazard Data		
Flash Point (Test Method) Auto Ignition Temperature (Setchkin) 370°C (700 °F)		700°F (370°C) ASTM-D-1929 Method B
Flammable Limits N/A	LEL N/A	UEL N/A
Extinguishing Media Water, Foam, Carbon Dioxide, Dry Chemical, Synthetic Foams, Alcohol Resistant Foams		
Special Fire Fighting Procedures: Soak thoroughly with water to cool and prevent re-ignition. The smoke can contain polymer fragments of varying composition, in addition to unidentified toxic and/or irritating compounds.		
Unusual Fire & Explosion Hazards Combustion by-products include, but are not limited to, carbon dioxide and carbon monoxide.		

QwikDuct HDPE Custom Templates

Material Safety Data Sheet

V. Health Hazard Data	
OSHA Permissible Exposure Limit 15 mg/m3 Total dust, 5 mg/m³ respirable dust	ACGIH Threshold Limit Value 10 mg/m³ (total dust)
Carcinogen - NTP Program – NO	Carcinogen - IARC Program – NO
Symptoms of Exposure – None Known	
Medical Conditions Aggravated By Exposure None known, however, seek medical attention if constant irritation occurs. If thermal decomposition occurs, respiratory, eye, nose, and throat irritation may result.	
Primary Route(s) of Entry – Inhalation of particulates.	
Emergency First Aid – Molten material. If molten material comes in contact with the skin, cool under running water. Do not attempt to remove the molten material from the skin. Get medical attention.	
VI. Reactivity Data	
STABILITY ____ Unstable <u>X</u> Stable	Conditions To Avoid – None Known Materials To Avoid – Strong Oxidizing Agents Conditions To Avoid – None Known
INCOMPATIBILITY Hazardous Polymerization ____ May Occur <u>X</u> Will Not Occur	
Hazardous Decomposition Products: Alphatic Hydrocarbons	
VII. Environmental Protection Procedures	
Spill Response... Sweep up for disposal or reuse.	
Waste Disposal Method... Incineration or landfill - dispose of in accordance with Federal, State and Local regulations.	
VIII. Special Precautions	
Eye Protection – Glasses with side shields in dusty conditions.	
Skin Protection – Use insulated gloves when handling molten material.	
Respiratory Protection (Specific Type) – NIOSH approved dust respirator recommended. If material is being burned wear an organic respirator.	
Ventilation Recommended – Local ventilation in dusty conditions, or if thermal decomposition occurs.	
Other Protection – Gloves and protective garments when handling molten material.	
IX. Special Precautions	
Hygienic Practices In Handling & Storage – Wash with soap and water.	
Precautions For Repair & Maintenance Of Contaminated Equipment – Eliminate ignition sources.	
Other Precautions – Store in a sprinkler protected warehouse. Since High density is a polyethylene, it will burn wit a hot flame if ignited. Avoid contact with ignition sources such as open flames. Keep a fire extinguisher near if welding is done in the area of High Density Polyethylene. If a heat source is present, keep the area well ventilated.	
NFPA CODE: Fire 1, Health 1, Reactivity 0	HMIS CODE: Fire 1, Health 1, Reactivity 0

QwikDuct HDPE Custom Templates

Material Safety Data Sheet

X. Regulatory Information

OSHA Status – 15 mg/m³ Total dust, 5 mg/m³ respirable dust

TSCA Inventory Status – All ingredients are listed.

CERCLA Reportable Quantity (RQ) – None

SARA Title III –

Section 302/304 – No extremely hazardous substances

Section 311/312 – No reporting requirements although it is suggested that storage of >10,000 lbs of polyethylene in one facility should be listed on a Tier II report.

Section 313 – No reporting requirements.

Hazard data contained herein was obtained from raw material suppliers. The information presented is believed to be factual, as it was derived from the works and opinions of persons believed to be qualified. However, no facts contained in the information are to be taken as a warranty, or representation, for which SP Products Inc. bears legal responsibility. The user should review any recommendation in the specific context of the intended use to determine if they are appropriate.